


Rev	ECN/DDC	DESCRIPTION	DATE	DRAFT	CHECK	APV'D
A	----	Initial Release.	12-12-24	V.J.C.	T.D.N.	V.J.C.

**Class I, Division 2, Groups A, B, C and D;
Class II, Division 2, Groups F and G;
Class III or Unclassified Area**

Unclassified Area

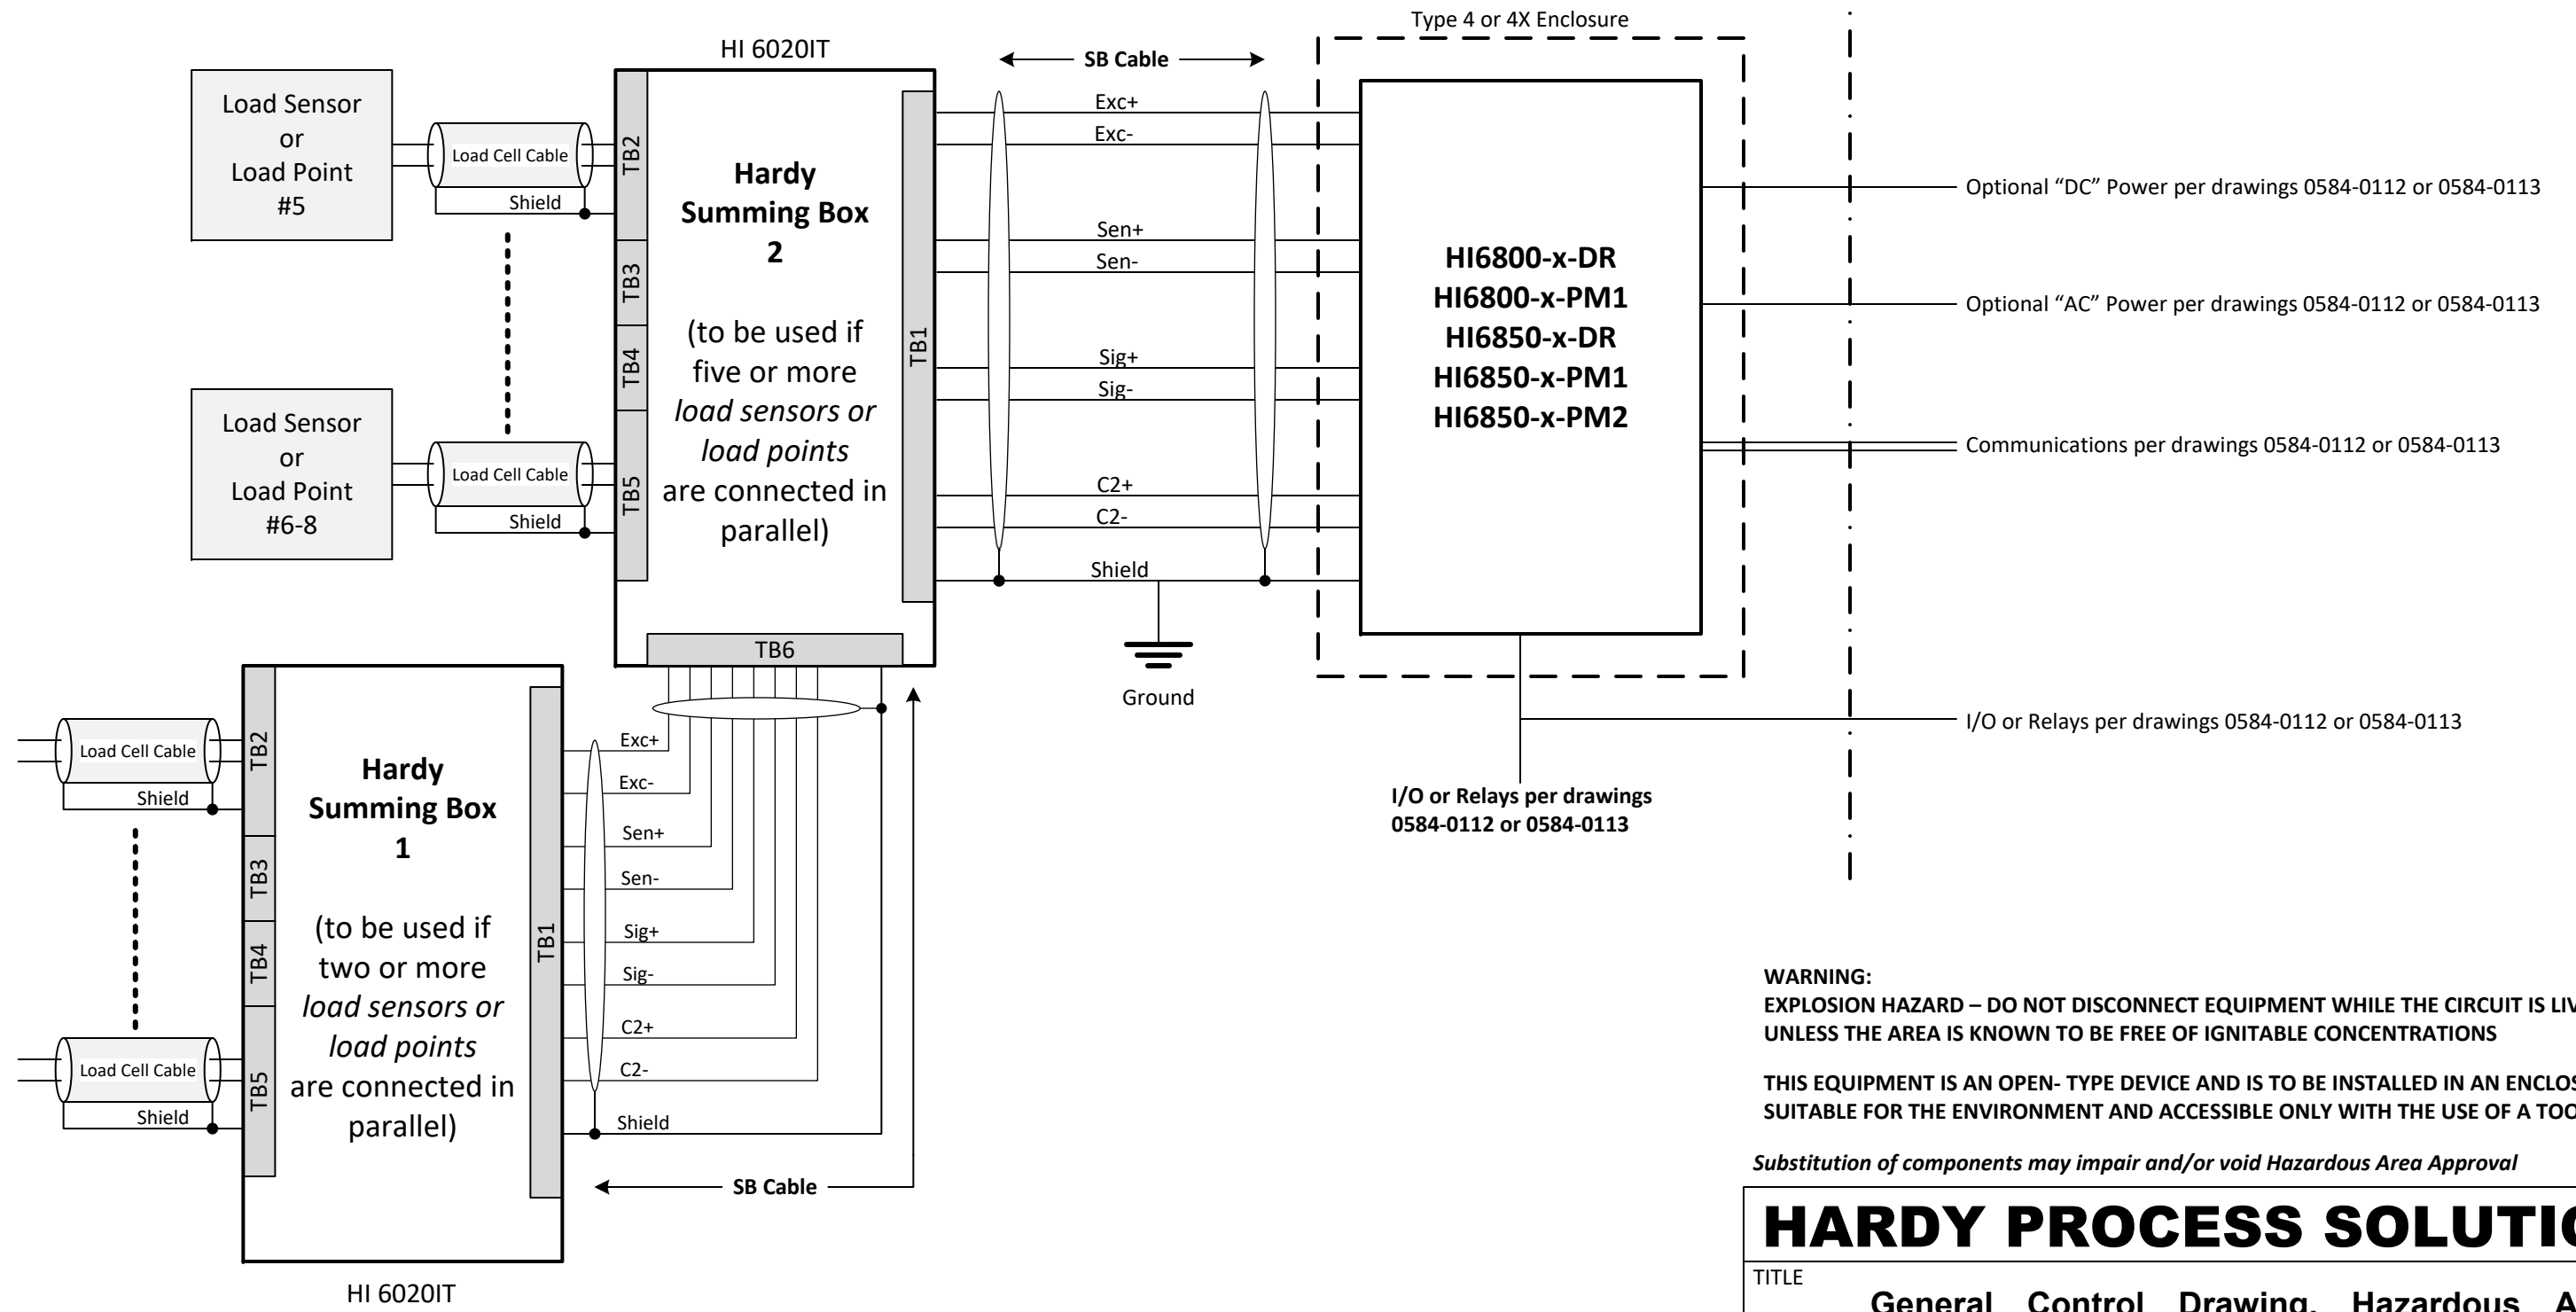

WARNING:
EXPLOSION HAZARD – DO NOT DISCONNECT EQUIPMENT WHILE THE CIRCUIT IS LIVE OR UNLESS THE AREA IS KNOWN TO BE FREE OF IGNITABLE CONCENTRATIONS

THIS EQUIPMENT IS AN OPEN- TYPE DEVICE AND IS TO BE INSTALLED IN AN ENCLOSURE SUITABLE FOR THE ENVIRONMENT AND ACCESSIBLE ONLY WITH THE USE OF A TOOL.

Substitution of components may impair and/or void Hazardous Area Approval

HARDY PROCESS SOLUTIONS					
TITLE General Control Drawing, Hazardous Area Apparatus System, HI6800 Series With HI6020IT					
SIZE D	FSCM 21316	DRAWING NO. 0594-0014			REV. A
FILE NAME: 0594-0014A1.VSD		SCALE: NONE	SHEET 1	OF 1	