


REV.	ECO/DDC	DESCRIPTION	DATE	DRAFT	CHECK	APV'D
A	----	RELEASED.	03-21-12	V.J.C.	L.E.G.	V.J.C.
b	11870	REVISED PER ECN.	09-19-16	V.J.C.	L.E.G.	V.J.C.

HAZARDOUS AREA

NON-HAZARDOUS AREA

APPROVED FOR CLASS I, II AND III, DIVISION 1,
GROUPS A, B, C, D, E, F AND G HAZARDOUS LOCATIONS.

$V_{max} = 29.9 \text{ V.}$
 $I_{max} = 0.450 \text{ A.}$
 $C_i = 0.$
 $L_i = 0.$

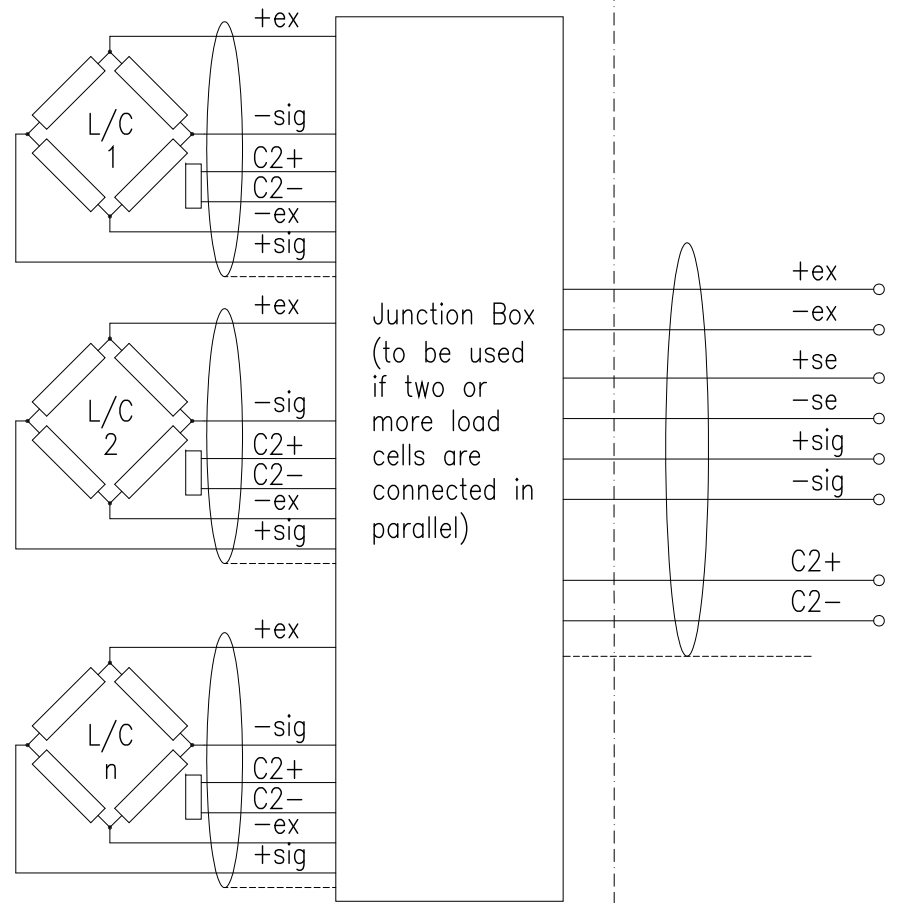

The Entity Concept allows interconnection of intrinsically safe apparatus with associated apparatus when the following is true:

$V_{max} \geq V_{oc}, V_t \text{ or } U_o;$
 $I_{max} \geq I_{sc}, I_t \text{ or } I_o \text{ (Combined } I_{sc}, I_t \text{ or } I_o \text{ of ALL BARRIERS } \leq I_{max});$
 $C_a \geq C_i + C_{cable};$
 $L_a \geq L_i + L_{cable}.$

- NOTES:**
- MAX. CABLE LENGTH = 100 FT.
 - n = MAX. NUMBER OF LOAD CELLS THAT CAN BE CONNECTED IN PARALLEL WITHOUT EXCEEDING MAX. TOTAL CAPACITANCE AND MAX. TOTAL INDUCTANCE.
 - INSTALLATION SHOULD BE IN ACCORDANCE WITH ANSI/ISA RP12.06.01 "INSTALLATION OF INTRINSICALLY SAFE SYSTEM FOR HAZARDOUS (CLASSIFIED) LOCATIONS" AND THE NATIONAL ELECTRICAL CODE (ANSI/NFPA 70)
 - APPARATUS CONNECTED TO THE SYSTEM SHALL NOT USE OR GENERATE VOLTAGE GREATER THAN 250 V.
 - INSTALL INTRINSIC SAFE BARRIERS IN ACCORDANCE WITH BARRIER INSTRUCTIONS.
 - SUBSTITUTION OF COMPONENTS MAY VOID FACTORY MUTUAL APPROVAL.
 - THE ASSOCIATED APPARATUS MUST BE FM APPROVED
 - NO REVISION TO DRAWING WITHOUT PRIOR FM APPROVAL

THE LIST BELOW APPLIES TO ALL FOUR (4) PAGES

APPROVED LOAD CELLS:
HI SBH04-a, HI SB05-a, HI BBH06-b, HI RCH01-d, HI RCH03-d, HI RCH04-d
HI SP1-b, HI SPA60-g, HI SP6-b, HI SPA42-b, HI SPA22-b, HI SP3-b
HI SB01-f, HI SB02-a, HI SBHF14-a, HI PB-e, HI SPB1-g, HI SP7-b
HI HBB01-b, HI HP50-h,

APPROVED FORCE TRANSDUCERS:
HI STH01-a, HI STH06-b, HI STLB-a

a = Capacity any between 100 kg and 10 ton; 200 lb and 20 klb; 1 kN and 100 kN.
b = Capacity any between 5 kg and 500 kg; 10 lb and 1 klb; 50 N and 5 kN.
d = Capacity any between 5 klb and 500 klb; 2 ton and 300 ton, 20 kN and 2.5 MN.
e = Capacity any between 0.5 kg and 2500 kg; 1 lb and 5 klb; 5 N and 25 kN.
f = Capacity any between 200 lb and 20 klb; 100 kg and 10000 kg; 1kN and 100 kN.
g = Capacity any between 20 kg and 1000 kg; 50 lb and 2000 lb; 200 N and 10 kN.
h = Capacity any between 100 kg and 100 ton; 200 lb and 200 klb; 1 kN and 1 MN.

PROPRIETARY NOTICE
ALL DATA AND INFORMATION CONTAINED IN OR DISCLOSED BY THIS DOCUMENT IS CONFIDENTIAL AND PROPRIETARY INFORMATION OF HARDY PROCESS SOLUTIONS INC. AND ALL RIGHTS THEREIN ARE EXPRESSLY RESERVED. BY ACCEPTING THIS MATERIAL THE RECIPIENT AGREES THAT THIS MATERIAL AND THE INFORMATION CONTAINED THEREIN IS HELD IN CONFIDENCE AND IN TRUST AND SHALL NOT BE USED, COPIED, REPRODUCED IN WHOLE OR IN PART, NOR ITS CONTENTS REVEALED IN ANY MANNER TO OTHERS, EXCEPT TO MEET THE SPECIFIC PURPOSE FOR WHICH IT WAS DELIVERED.

ITEM	QTY	PART NUMBER	DESCRIPTION	COMMENTS
0594-0005 General Control Drawing, Entity Mode, Hardy Load Sensors				
PARTS LIST				
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN IN [MM]		CONTRACT NO.		
TOLERANCES ARE:		APPROVALS		
FRACTIONS: N/A		DRAWN	DATE	<p>General Control Drawing, Entity Mode, Hardy Load Sensors</p>
DECIMALS: .XX = N/A		V. CHULA	01-31-12	
.XXX = N/A		CHECKED	DATE	
ANGLES: ±0°, 30'		L. GUIRIBA	03-21-12	
MATERIAL		APPROVED	DATE	
FINISH		V. CHULA	03-21-12	SIZE
DO NOT SCALE DRAWING		ISSUED	DATE	FSCM
		V. CHULA	03-21-12	DRAWING NO.
		PRODUCTION	DATE	REV.
				D 21316 0594-0005 B
		FILE NAME: 594005B1.DWG		SCALE: NONE
		SHEET 1 OF 1		